


| MODULE: R0224 | | | ADDRESS: 01 | |
|---------------|---------|----------|------------------|---------------|
| ZONE | CHANNEL | OUTPUT | DESCRIPTION | PANEL/CIRCUIT |
| 1 | a | RE-01-01 | | |
| | | PL | RE-01-02 | |
| 1 | a | AO-02-01 | | |
| | | AO-02-02 | | |
| ZONE | CHANNEL | OUTPUT | DESCRIPTION | PART NUMBER |
| 1 | a,PL | UI-02-01 | Occupancy Sensor | BOS-515NSA |
| | | UI-02-02 | | |
| 1 | a | UI-02-03 | Light Sensor | BPD-500SS |
| | | UI-02-04 | | |

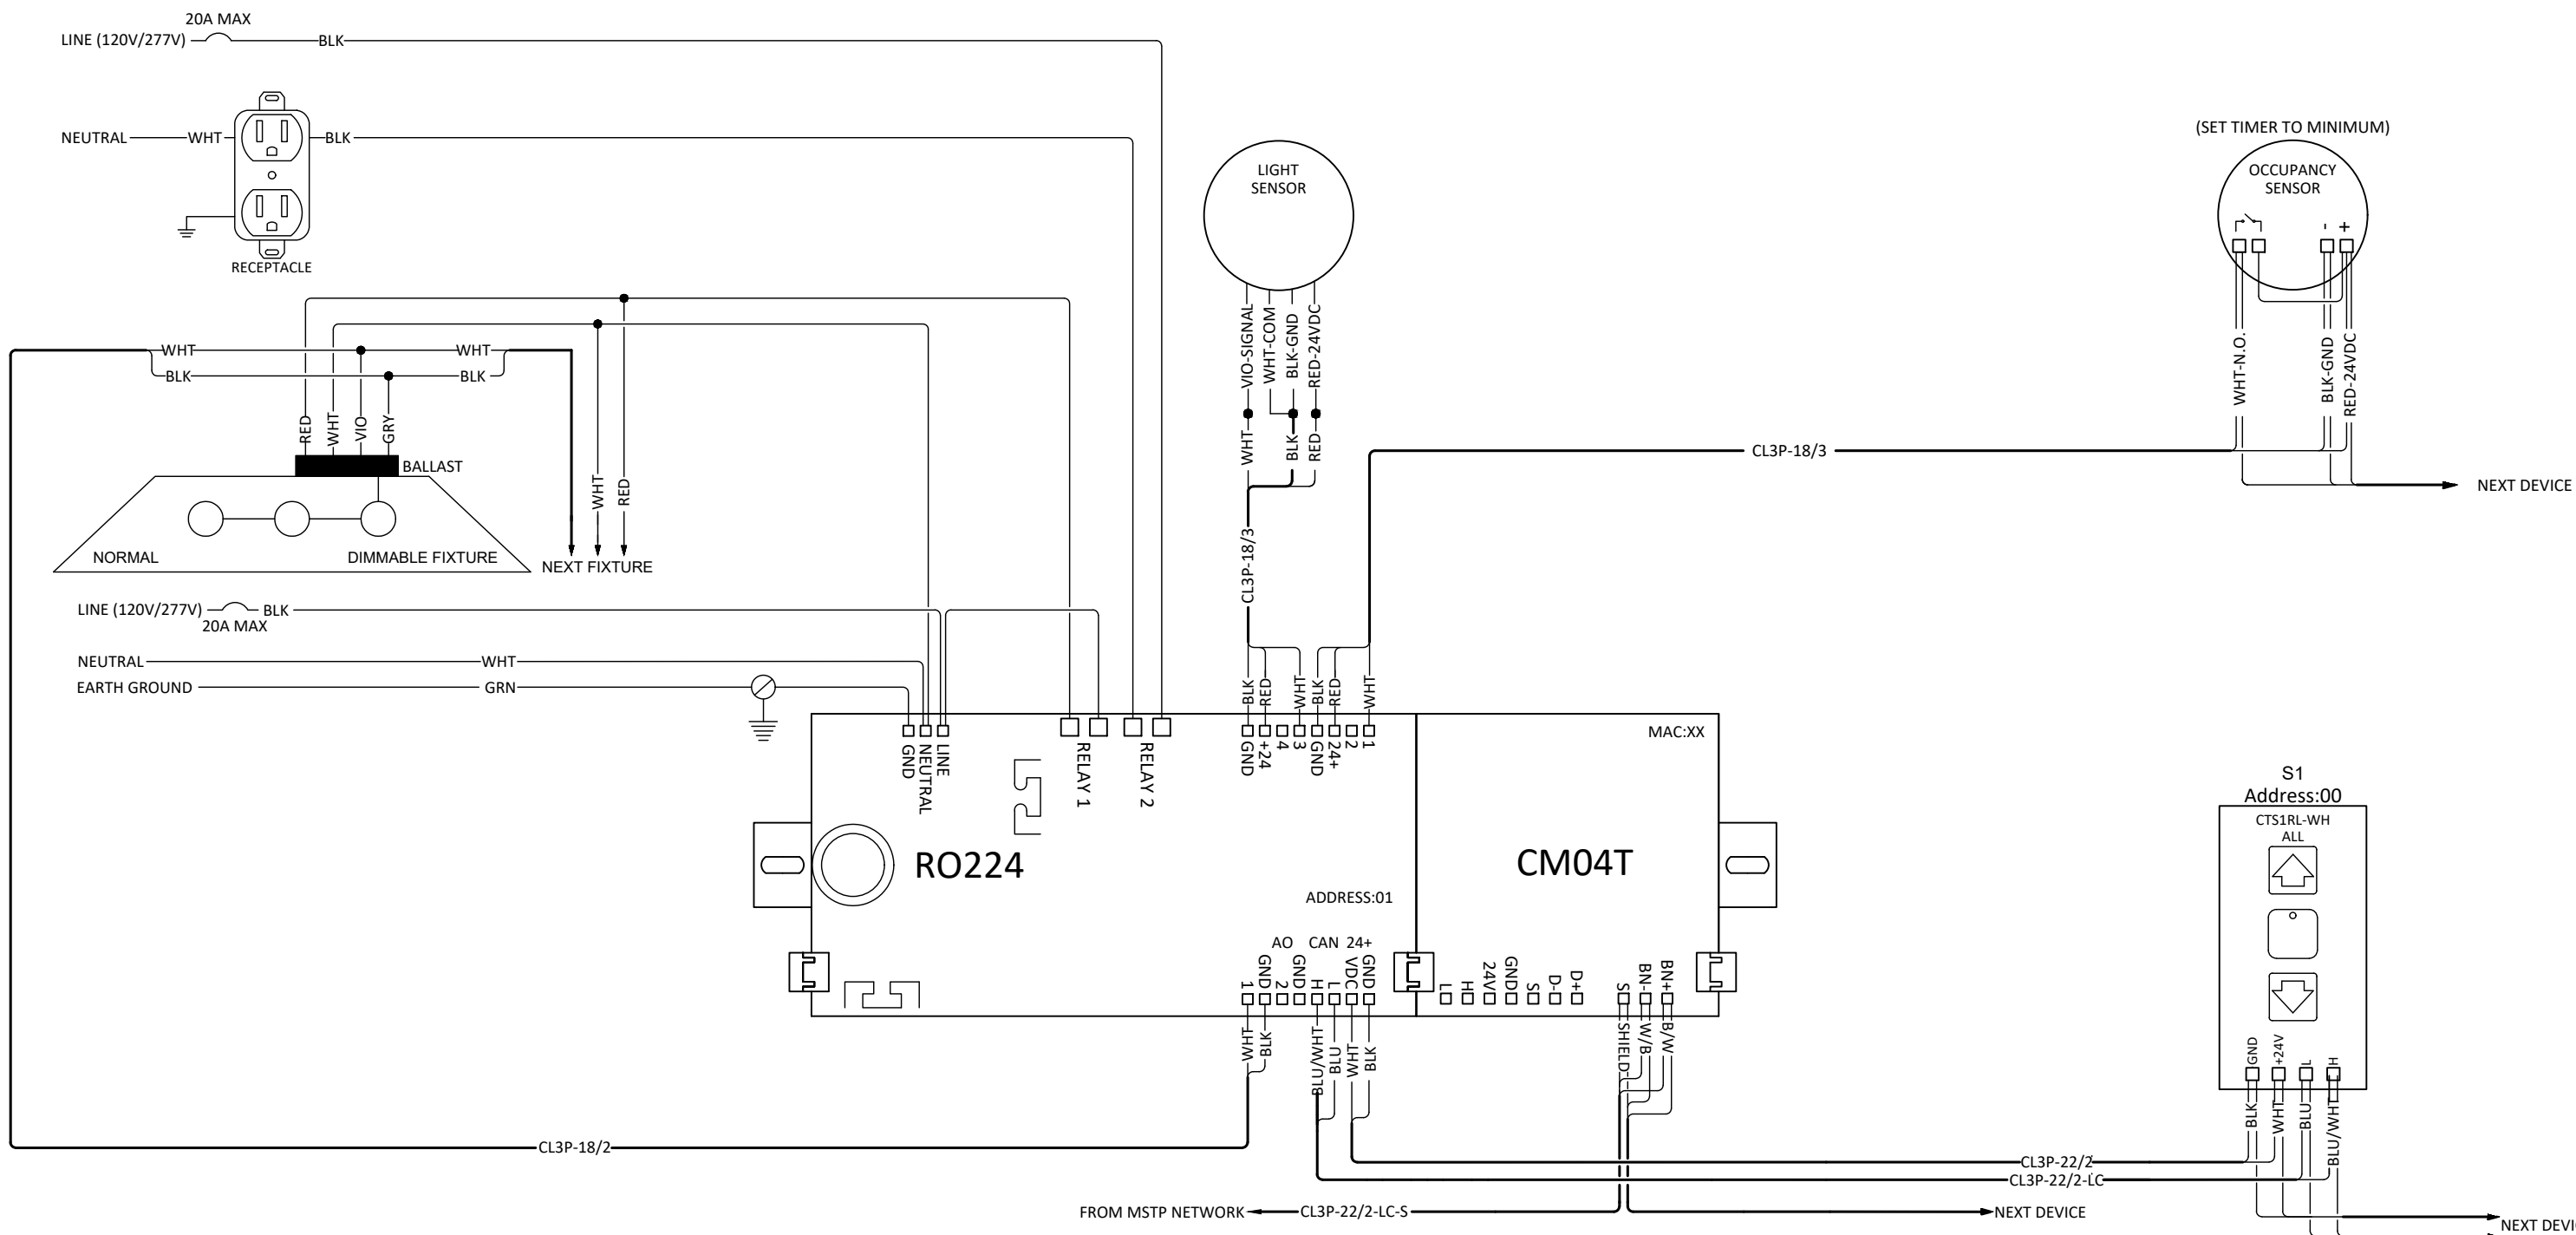

ENGINEERING STANDARDS
TZW-ZC0330A0-10

Typical Zone Wiring

| | | | |
|-----------|----------------------|----------------|--------|
| Rev: 1.01 | Type: Wiring Typical | Date: 05-21-19 | Job #: |
|-----------|----------------------|----------------|--------|

BLUE RIDGE TECHNOLOGIES™
UNIFIED LIGHTING CONTROL

| |
|-----------------|
| Engineered: WCD |
| Drawn: SWA |
| Checked: WCD |
| Page: 1 of 1 |

NOTE: For wire requirements see Cabling Data Sheet.