



1 System Diagram Detail



\* Refer to Sheet Lx5ASN\_PD\_PW\_AC for Addressable Switch Network details.

**WIRING KEY**

	A
	B
	C
	D
	2 - Control Power
	2 - Dry Contacts (N.C.)
	(3) Line Voltage Wires

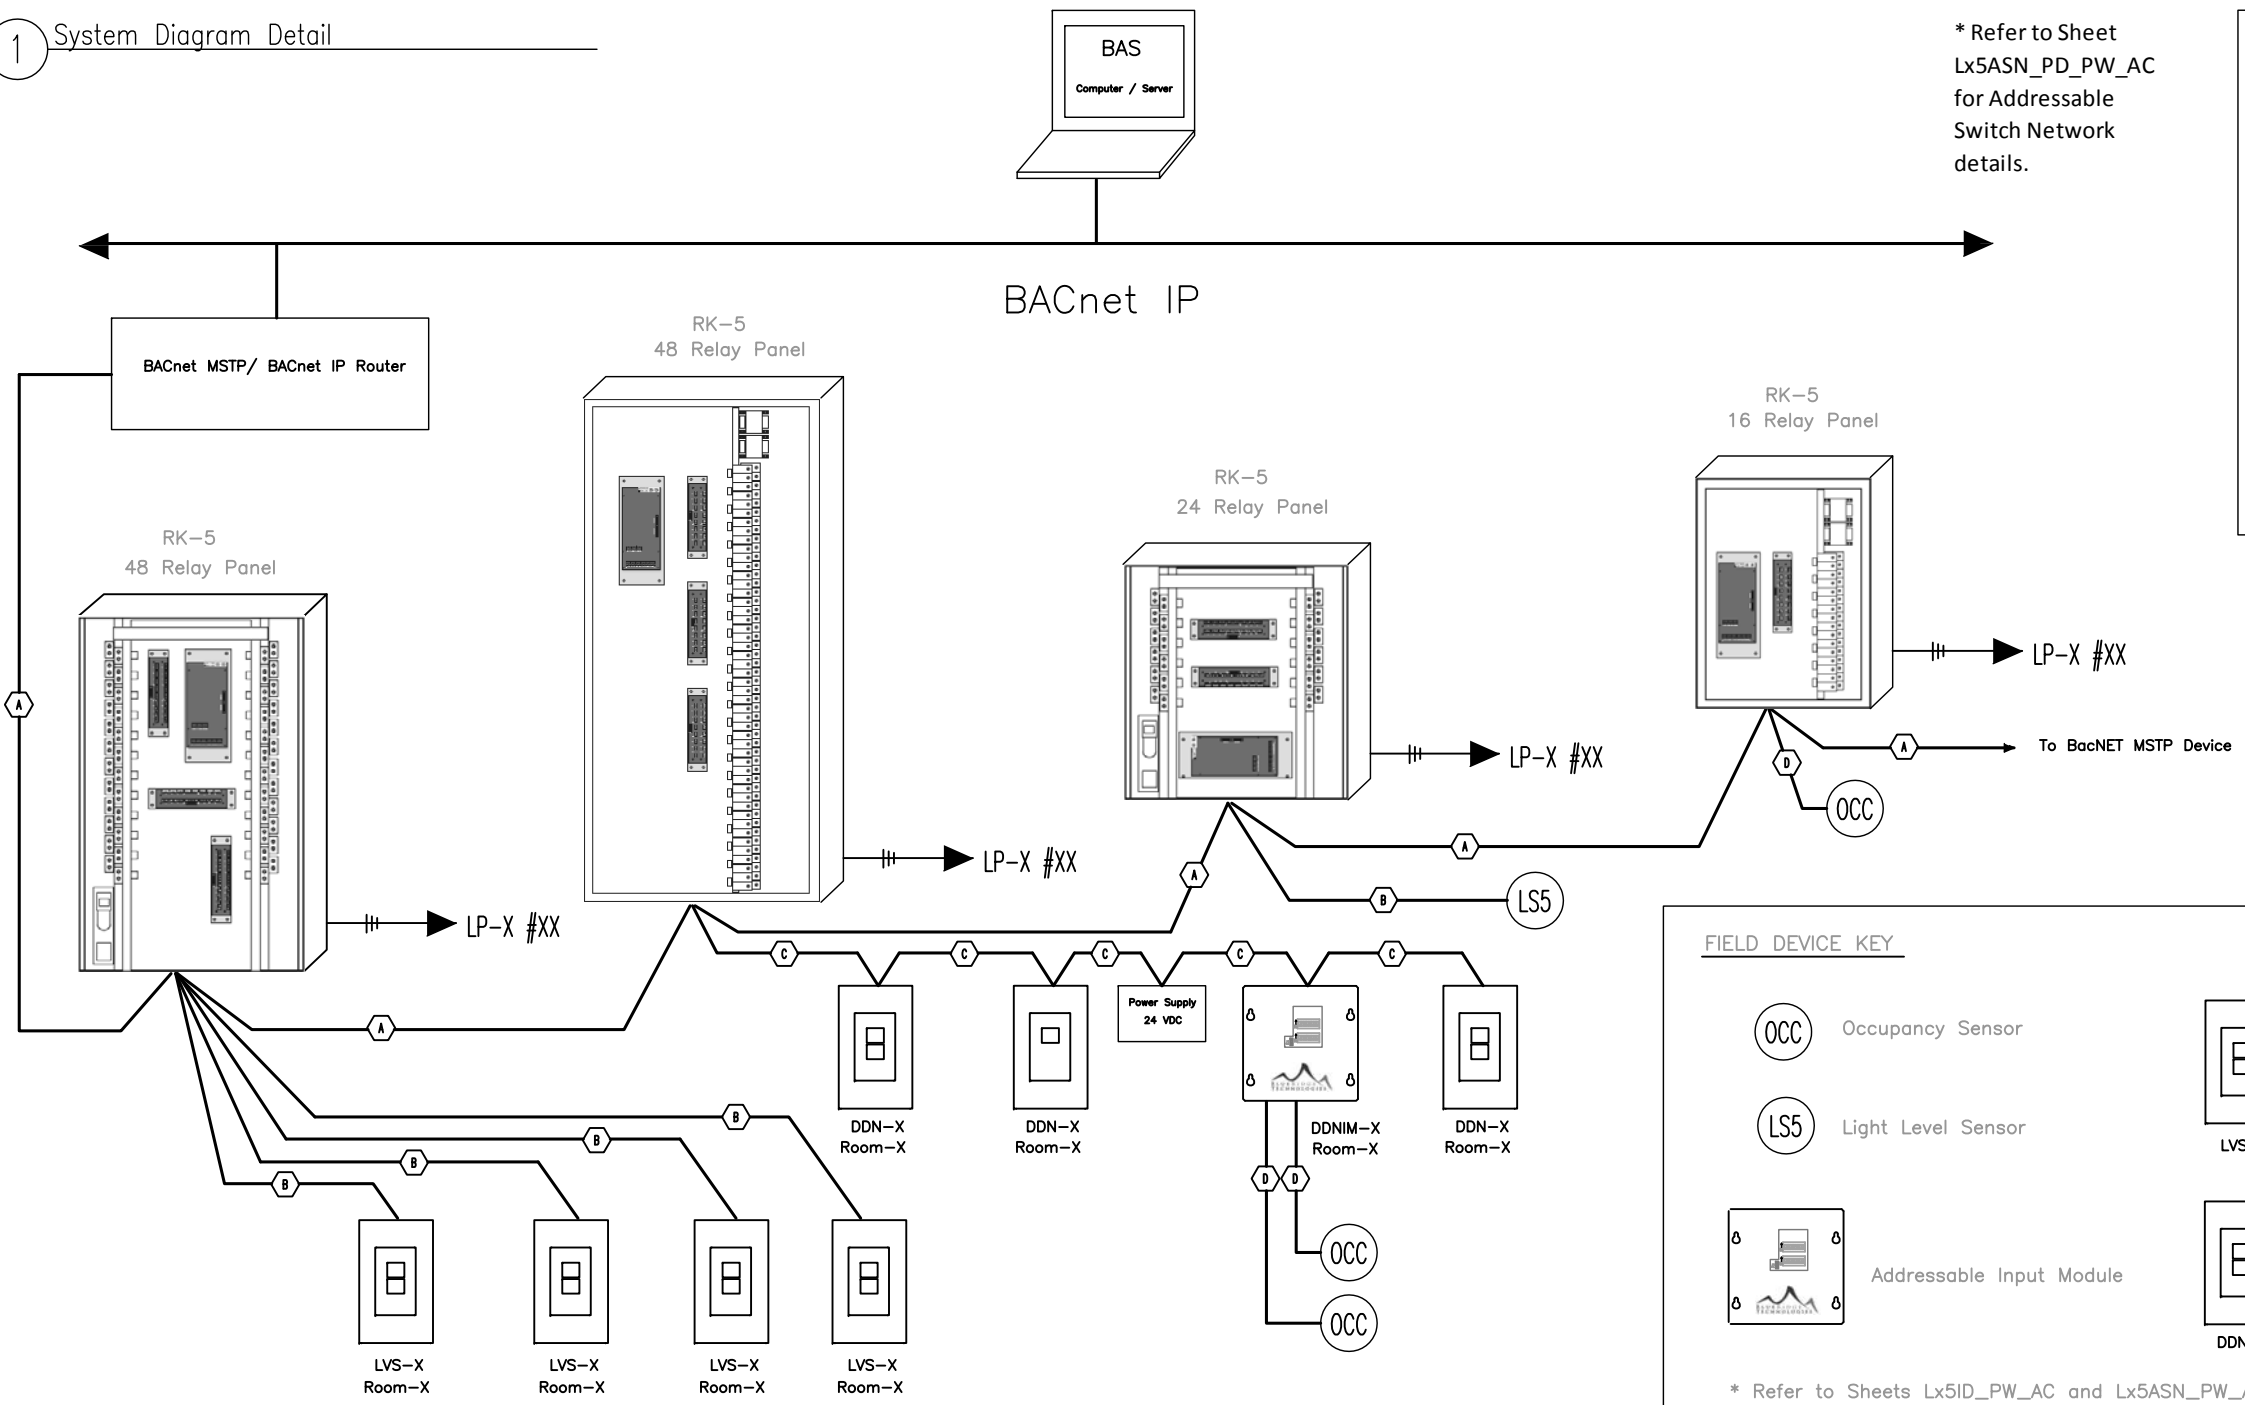

**FIELD DEVICE KEY**

	OCC	Occupancy Sensor		LVS-X	Low Voltage Switch
	LS5	Light Level Sensor		DDN-X	Addressable Switch
		Addressable Input Module			

\* Refer to Sheets Lx5ID\_PW\_AC and Lx5ASN\_PW\_AC for Field Device details.



1800 Sandy Plains Ind. Pkwy., Suite 216  
 Marietta, Georgia 30066  
 Ph: 770-790-4880 Fax: 770-790-4883  
<http://www.BRTINT.com>

Product: RK-5 System One Line Detail

Engineered by: CCJ Date: 05/09/2011  
 Drawn by: CCJ  
 Checked by: RP

Rev.	Date	By	Description	Sheet
				RK5_SYS_ONE_LINE